



All TSOs' proposal for the Key Organisational Requirements, Roles and Responsibilities (KORRR) relating to Data Exchange in accordance with Article 40(6) of Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a Guideline on Electricity Transmission System Operation

01/10/2018

Whereas	3
TITLE 1 General Provisions	5
Article 1 Subject matter and scope	5
Article 2 Definitions	6
Article 3 General responsibilities.....	7
Article 4 Confidentiality.....	8
Article 5 Access to information	8
TITLE 2 Key Organisational Requirements, Roles and Responsibilities	8
Chapter 1 Responsibilities of TSOs	8
Article 6 General Responsibilities.....	9
Article 7 Structural data used by TSOs	9
Article 8 Notification of changes	10
Article 9 Responsibilities of TSOs	10
Article 10 Format of Real Time Information.....	11
Chapter 2 Responsibilities of DSOs	11
Article 11 Notification of changes	11
Article 12 Rights and responsibilities of DSOs.....	12
Article 13 Real Time Data provided by DSOs.....	12
Chapter 3 Responsibilities of SGUs	13
Article 14 Structural Data provided by SGUs.....	13
Article 15 Notification of changes	13
Article 16 Scheduled Data provided by SGUs.....	13
Article 17 Real Time Data provided by SGUs.....	14
TITLE 3 Final provisions	14
Article 18 Implementation date of the KORRR.....	14
Article 19 Language	14

All TSOs, taking into account the following,

Whereas

- (1) This document regarding the key organisational requirements, roles and responsibilities relating to data exchange (hereinafter referred to as “KORRR”) takes into account the general principles and goals set in Commission Regulation (EU) 2017/1485 establishing a guideline on electricity transmission system operation (hereinafter referred to as “SO GL”), Commission Regulation (EU) 2015/1222 establishing a guideline on capacity allocation and congestion management, (hereinafter referred to as “CACM”), as well as, Commission Regulation (EU) 2017/2195 establishing a guideline on electricity balancing (hereinafter referred to as “EB GL”). The purpose of the SO GL is to safeguard operational security, frequency quality and the efficient use of the interconnected system and resources. To achieve these goals, it is necessary that each party of the electric system has the necessary observability of the network elements and services that impact their activities. Especially relevant is the global demand-generation balance through the procurement of balancing services and activation of balancing energy bids, where EB GL assigns the responsibility to the transmission system operators (hereinafter referred to as “TSOs”). The KORRR addresses in particular the key roles, requirements and responsibilities of the TSOs, the distribution system operators (hereinafter referred to as “DSOs”), the closed distribution system operators (hereinafter referred to as “CDSOs”) and the significant grid users (hereinafter referred to as “SGUs”) in relation to the data exchange necessary to ensure that observability.
- (2) The KORRR takes into account and complements where necessary the operational conditions and requirements set out in the generation and load data provision methodology (hereinafter referred to as “GLDPM”) developed in accordance with Article 16 of CACM. While the GLDPM establishes which data has to be provided by whom and when to prepare the common grid model, the KORRR addresses who must exchange data as well as, how and when to perform the tasks defined in the SO GL. Furthermore, the GLDPM only refers to data exchange up to the day ahead, while KORRR also includes data exchange up to real time.
- (3) Article 40(5) of the SO GL specifies that TSOs shall determine, in coordination with DSOs and SGUs, data exchange applicability and scope based on the a) to d) categories in Article 40(5) referring to specific articles in Title II of the SO GL. Applicability is therefore to be determined at a national level and is subject to approval by the competent authority (National Regulatory Authority or another entity designated by the Member State).
- (4) The content of the KORRR document has been created based on the scope for the methodology specified in Article 40(6) of the SO GL. Data exchange, following the SO GL, shall be necessary to perform security analysis and to guarantee operational security in the electric system. A certain level of harmonization shall be achieved, but to allow national or regional specificities, the KORRR shall not define the detailed information to be exchanged between TSOs and significant stakeholders, the KORRR shall establish the responsibilities at a national level of who shall define and approve the detailed information to be exchanged.
- (5) Article 40(7) of the SO GL specifies the TSOs’ obligation to agree with relevant DSOs on the process for exchanging information between them, including the format of data exchanges.
- (6) The KORRR shall ensure the provision of data necessary to perform the security analysis in accordance with Article 75 of the SO GL which specifies the obligation of TSOs to develop a methodology for coordinating operational security analysis.

- (7) Articles 40(8), 40(9) and 40(10) of the SO GL consider and regulate the exchange of information from TSOs to DSOs and/or SGUs. In this sense, the KORRR needs to consider bidirectional flows of information between all affected parties and takes into account the articles related to confidentiality and accessibility of data.
- (8) Article 6(6) of the SO GL requires a proposed implementation time scale and a description of the expected impact of the KORRR on the objectives of the SO GL. The KORRR has a fundamental impact on many of the objectives of the SO GL and it has been written taking into account the principles of proportionality and non-discrimination. The KORRR sets out the obligations of all the involved participants and in doing so removes barriers to the data exchange. The KORRR sets a pan EU framework which delivers an efficient process at the lowest total cost for all involved parties. By specifying minimum requirements on data exchange methods, planning, formats and content the KORRR helps achieve a more coordinated and secure system.
- (9) The main added value of the KORRR is to define a common framework for data exchange between the different parties involved in the security of the electricity system. This common framework furthers the SO GL aim of determining common operational security requirements and principles in accordance with Article 4(1) (a) of the SO GL. The KORRR will address the organisation of the data exchange so each party can get the necessary data to have observability of the part of the network that impacts their operational security. This data will underpin many of the operational security processes set out in the SO GL and is therefore required for each party to comply with the SO GL requirements.
- (10) With the aim of determining common operational planning principles as required in Article 4(1) (b) of the SO GL, the KORRR allows for the receipt of data required to prepare scenarios to perform operational security analysis in the planning stage, as it is compulsory a combination of the structural and the real time information to perform that operational security analysis.
- (11) The KORRR includes the organisation to exchange, among other, real time data, and the provision of services to determine common load-frequency control processes and control structures as required in Article 4(1) (c) of the SO GL.
- (12) To ensure the conditions for maintaining operational security throughout the Union as specified in Article 4(1) (d) of the SO GL, TSOs need to have good observability of the system in order to perform reliable security analysis. The KORRR aims to set the framework for the TSOs to access necessary data for their respective observability area and prepare accurate scenarios.
- (13) Data exchanges on capabilities and active power production are necessary for TSOs to follow processes to maintain a frequency quality level for all synchronous areas throughout the Union as defined in Article 4(1) (e) of the SO GL.
- (14) The KORRR takes into account the exchange of structural and scheduled data between TSOs and DSOs to perform security analysis before and in real time to promote the coordination of system operation and operational planning as defined in Article 4(1) (f) of the SO GL.
- (15) Article 4(1) (g) of the SO GL aims at ensuring and enhancing the transparency and reliability of information about transmission system operation. The KORRR establishes the framework to regulate necessary information among different parties in the electric system to ensure operational security.
- (16) The KORRR will contribute to the efficient operation and development of the electricity transmission system and the electricity sector in the Union while having good observability of the system to perform reliable security analysis which help to identify improvements in the transmission system.

(17)The KORRR contributes to the general objectives of the SO GL to the benefit of all TSOs, DSOs, SGUs, consumers, market participants, the Agency and regulatory authorities.

SUBMIT THE FOLLOWING KEY ORGANISATIONAL REQUIREMENTS, ROLES AND RESPONSIBILITIES RELATING TO DATA EXCHANGE TO ALL REGULATORY AUTHORITIES:

TITLE 1

General Provisions

Article 1

Subject matter and scope

1. The KORRR as defined in the present document shall be considered the common proposal developed by all TSOs of the European Union in accordance with Article 40(6) of the SO GL and shall include organisational requirements, roles and responsibilities for data exchange according to Title II of the SO GL.
2. The KORRR shall apply to all transmission systems, distribution systems and interconnections in the Union, in the area referred to in Article 2(2) of the SO GL.
3. The KORRR shall apply to SGUs as referred to in Article 2(1) of the SO GL. SGUs that provide services to the system individually or through an aggregator shall comply with prequalification rules defined at a national level. The roles and responsibilities of an aggregator shall be defined in the respective service provision agreements in observance of national prequalification rules.
4. The KORRR shall apply to:
 - a. CDSOs in their roles as relevant system operators. For the purposes of KORRR, CDSOs shall be considered as DSOs, as stated in Article 3(1) of the Commission Regulation (EC) 1388/2016 establishing a Network Code on Demand Connection (hereinafter referred to as "NC DCC"), and the requirements and responsibilities described shall apply accordingly.
 - b. Transmission-connected CDSOs in their roles as SGUs in accordance with Article 2(1) of the SO GL and, if determined at a national level within the applicability and scope of data exchanges subject to KORRR.
5. When applying the KORRR, system operators shall:
 - a. apply the principles of proportionality and non-discrimination;
 - b. ensure transparency;
 - c. apply the principle of optimisation between the highest overall efficiency and lowest total costs for all parties involved;
 - d. respect the responsibility assigned to the relevant TSO to ensure system security, as required by national legislation;
 - e. consult with relevant DSOs and take account of potential impacts on their system; and
 - f. follow agreed European standards and technical specifications.
6. TSOs from jurisdictions outside the area referred to in Article 2(2) of the SO GL may adopt the KORRR on a voluntary basis, provided that:
 - a. For them to do so is technically feasible and compatible with the requirements of the SO GL.

- b. They agree that they shall have the same rights and responsibilities with respect to the data exchange process as the TSOs referred to in paragraph 2, in particular, they shall accept that the KORRR applies to the relevant parties in their control area as well.
 - c. They accept any other legally feasible conditions related to the voluntary nature of their participation in the data exchange process that the TSOs may set.
 - d. The TSOs referred to in paragraph 1 have concluded an agreement governing the terms of the voluntary participation with the TSOs referred to in this paragraph.
 - e. Once TSOs participating in the data exchange process on a voluntary basis have demonstrated objective compliance with the requirements set out in (a), (b), (c) and (d), of this paragraph, the TSOs referred to in paragraph 1, after checking that the criteria in (a), (b), (c) and (d) are met, have approved an application from the TSO wishing to join the KORRR process in accordance with the procedure set out in Article 5(3) of the SO GL.
7. The TSOs referred to in paragraph 2 shall monitor whether those TSOs participating in the data exchange process on a voluntary basis pursuant to paragraph 6 respect their obligations. If a TSO participating in the data exchange process pursuant to paragraph 6 neglects its essential obligations in a way that significantly endangers the implementation and operation of the SO GL, the TSOs referred to in paragraph 2 shall terminate that TSO's voluntary participation in the data exchange process in accordance with the procedure set out in Article 5(3) of the SO GL.

Article 2 *Definitions*

1. For the purposes of the KORRR, terms used in this document shall have the meaning of the definitions included in Article 3 of the SO GL, Article 2 of CACM, Article 2 of Regulation (EC) 714/2009 on conditions for access to the network for cross-border exchanges in electricity, Article 2 of Commission Regulation (EU) 543/2013 on submission and publication of data in electricity markets, Article 2 of Commission Regulation (EC) 631/2016 establishing a network code on requirements for grid connection of generators (hereinafter referred to as "NC RfG"), Article 2 of NC DCC, Article 2 of the Commission Regulation (EC) 1447/2016 establishing a network code on requirements for grid connection of high voltage direct current systems and direct current-connected power park modules (hereinafter referred to as "NC HVDC"), as well as Article 2 of the Directive 2009/72/EC of the European Parliament and of the Council concerning common rules for the internal market in electricity and the other items of legislation referenced therein.
2. The KORRR shall be binding upon all TSOs, their permitted successors and assigns- and irrespective of any change in the TSOs' names- as well as upon any other entities covered by the SO GL including DSOs and SGUs.
3. In the KORRR, unless the context requires otherwise:
 - a. The singular indicates the plural and vice versa.
 - b. The table of contents, headings and examples are inserted for convenience only and do not affect the interpretation of the KORRR.
 - c. Any reference to legislation, regulations, directive, order, instrument, network code or any other enactment shall include any modification, extension or re-enactment of it then in force.

4. A modification in a network element, power generating module or demand facility is considered significant for the purpose of the KORRR when it is also considered significant in the NC RfG, the NC DCC or the NC HVDC. In this context, national specificities in the implementation process concerning the definition of the term “significant” need to be taken into account.
5. For the purpose of the KORRR, real time data means a representation of the actual state of the power generating modules, demand facilities or network elements when the data is measured.

Article 3 *General responsibilities*

1. Each TSO, DSO or SGU shall be responsible for the quality of the information they provide regarding their power generating modules, demand facilities or services to other parties.
2. On the basis of Articles 48 to 50 and 53 of the SO GL, the KORRR renders the provision of data both to TSOs and DSOs as the default option. This approach can be revised at a national level in order to allow SGUs the provision of data only to the TSO or to the DSO to which they are connected unless otherwise required to provide services to the system. In those cases where an SGU only provides data to a TSO or to a DSO to which they are connected, the TSO and the DSO shall exchange between them the data related to that SGU.
3. Subject to approval by the competent regulatory authority or by the entity designated by the Member State and according to Article 40 of the SO GL, it shall be determined at a national level whether distribution connected SGUs in their TSOs control area shall provide the structural, scheduled and real-time data to the TSO directly or through their connecting DSOs or to both. The decision on the data exchange model may be independent for each type of information and SGU, if required. When the data is provided to the DSO, the DSO shall provide the required data to the TSO with a data granularity necessary to comply with the requirements of the SO GL provisions.
4. When the TSO or the DSO receives the data directly from the SGU, the TSO or DSO shall check and endeavour to ensure that the data complies with the quality requirements specified by the TSO or, where applicable, by the DSOs before sharing it with another entity. The scope and the possible consequences of the quality check shall be defined at a national level.
5. Adjacent DSOs and/or the downstream DSO and upstream DSO shall inform each other on the processes and formats of any change in the data and information to be exchanged between them according to Article 40(6) of the SO GL.”
6. The responsibilities regarding the installation, configuration, security and maintenance of communication links for data exchange up to the communication interface point shall be defined at a national level.
7. Subject to the agreement of the TSO or the DSO in case of SGUs providing directly data to a DSO, parties required to provide data under the KORRR shall be allowed to delegate all tasks or parts hereof assigned to it under the SO GL to one or more third parties, in case the third party can carry out the respective function at least as effectively as the delegating entity. The delegating entity shall remain responsible for ensuring compliance with the obligations under the SO GL, including ensuring access to information necessary for monitoring by the regulatory authority.

*Article 4
Confidentiality*

1. Unless otherwise explicitly stated, all data affected by the KORRR shall be confidential. In accordance with Article 12 of the SO GL, each party receiving data according to the KORRR shall implement appropriate technical and organizational measures to ensure that data is not disclosed to any other person or authority, without prejudice to cases covered by national law, other provisions of the SO GL or other relevant Union legislation.
2. Subject to the confidentiality obligations set out in Article 12 of the SO GL, TSOs may share the data obtained with all other involved TSOs that have fully implemented the requirements set out in the KORRR, if necessary for carrying out the operational security analyses or for maintaining the operational security of their observability areas.

*Article 5
Access to information*

1. Each power generating module, demand facility or CDSO considered as a SGU according to Article 2(1) of the SO GL shall have access to the structural information referring to its facilities stored by the TSO or DSO.
2. Each DSO shall have access to the structural, scheduled and real-time information of the SGUs connected to its distribution network.
3. Unless otherwise provided by the EU or national legislation, the TSOs shall provide DSOs, with a connection point with the transmission system, access to the structural, scheduled and real-time information of the commissioned network elements of the transmission network, in accordance with Article 40(10) of the SO GL, if necessary for carrying out the operational security analyses or for maintaining the operational security of their grids. When the request of information comes from a CDSO, it may not include the connection point of other CDSOs or SGUs.
4. SGUs shall have access to the structural, scheduled and real-time information of the commissioned facilities of the transmission system or distribution system in their connection point. It shall not include the connection point of other SGUs.
5. Competent national regulatory authorities shall have access to all information exchanged subject to the KORRR upon request.
6. The TSOs may share structural information of DSOs or SGU with a third party to comply with the responsibilities defined in the SO GL, subject to the formalization of confidentiality and a limitation of use agreement.

TITLE 2

Key Organisational Requirements, Roles and Responsibilities

**Chapter 1
Responsibilities of TSOs**

Article 6
General Responsibilities

1. Each TSO shall communicate to the relevant TSOs, the elements of their transmission system identified as part of its observability area according to the methodology of Article 75 of the SO GL.
2. Each TSO shall communicate to the relevant DSOs of its control area, the elements of their distribution network identified as part of its observability area according to the methodology of Article 75 of the SO GL.
3. Each TSO shall provide updated information of the network elements in its transmission system that is part of the observability area of other TSO to those TSOs in accordance with Article 41 and 42(2) of the SO GL.
4. Each TSO shall exchange real-time data with the other TSOs of the same synchronous area in accordance with Article 42(1) of the SO GL.
5. Subject to approval of the competent regulatory authority or approval of the entity designated by the Member State in accordance with Article 40(5) of the SO GL, each TSO, in coordination with the DSOs and SGUs, shall define which SGUs in its control area shall provide the real time data.
6. Each TSO shall provide updated information of DSO networks of its control area that is part of the observability area of other TSOs to those TSOs.
7. Each TSO shall provide updated information of the neighbouring TSO networks which have an impact on the distribution networks of its own control area to the DSOs operating those distribution networks.
8. All transmission and distribution data to be exchanged between TSO control areas shall be exchanged only through TSOs unless otherwise required by national legislation or specific agreements.
9. TSOs shall use the operational planning data environment platform for the exchange of structural and scheduled information with other TSOs for data required in accordance with Articles 114, 115, 116 and 117 of the SO GL. All TSOs shall use the harmonized data format for data exchange among them in accordance with Article 114(2) of the SO GL.
10. Each TSO shall electronically store the information needed for its processes for the duration defined by national legislation.

Structural data

Article 7
Structural data used by TSOs

1. In agreement with relevant DSOs, according to Article 40(7) of the SO GL, each TSO shall specify the format and may publish templates for the structural data that DSOs shall provide. The format or template has to include the detailed content of the structural data that have to be provided.
2. Each TSO shall specify the format and may publish templates for the structural data that transmission connected SGUs and distribution connected SGUs that exchange data directly with the TSO shall provide, in line with Article 40(7) of the SO GL. The agreement between each TSO and the relevant DSOs referred to in Article 40(7) of the SO GL shall only be required for the involved DSOs. The format or template has to include the detailed content of the structural data that have to be provided.

Article 8
Notification of changes

1. Each TSO shall review the structural information it shares with other TSOs at least every 6 months. Each TSO shall provide updated information of the observability area to the neighbouring TSO as defined in an agreement between involved TSOs, or if it's not defined in an agreement in the following situations, however in both cases not less than 3 months before:
 - a. the planned commissioning of a new network element or SGU;
 - b. the planned final removal from service of the network element or SGU; and
 - c. the planned significant modifications in the network element or SGU.Moreover, each TSO shall provide updated information as soon as possible in case there is a change in the observability area and as soon as an error in the data set transmitted earlier is detected.
2. According to Articles 5(3) and 5(4), DSOs and SGUs may request an update of the structural data from its TSO.

Scheduled data

Article 9
Responsibilities of TSOs

1. Each TSO shall be capable of exchanging scheduled data with TSOs and with SGUs, DSOs or third parties within its control area to whom the exchange of scheduled information may have been delegated. Scheduled data shall at least include generation and consumption schedules between two days ahead and close to real time, unavailability or limitations to active power production or consumption of SGUs and unavailability of network elements in the TSO's observability area.
2. In agreement with DSOs within the TSOs' control area, each TSO shall specify the format and may publish templates to exchange the scheduled data between them.
3. In coordination with SGUs or third parties within TSOs' control area, each TSO shall define and publish the format of the information for the exchange of scheduled data.
4. Each TSO shall define and publish the technical requirements, including time stamping, for the exchange of scheduled data with SGUs, DSOs or third parties within its control area. The technical requirements should where possible, be in accordance with an international standard recommended by all TSOs and with current technologies to guarantee the security, confidentiality and redundancy of the communications.
5. Each TSO shall communicate to the DSOs connected to the transmission system their planned and unplanned unavailability of network elements in their connection point. For planned unavailability, they shall agree on the necessary level of coordination and communication between them. For unplanned unavailability, the TSO shall communicate to them as soon as possible.
6. Each TSO shall communicate to each SGU, connected to the transmission system, their planned and unplanned unavailability of network elements in the SGU's connection point.

Real Time data

Article 10

Provisions of Real Time Information

1. Each TSO, in agreement with the DSOs in its control area, shall specify and publish the list of detailed content for real time data exchange and the format for real-time data exchange between them related to the distribution network observability area within its control area.
2. Each TSO, in coordination with SGUs and DSOs, shall specify and publish the list of detailed content for real time data exchange and the format for real time data exchange related to SGUs within its control area.
3. Each TSO shall specify the technical requirements, including time stamping, for real time data exchange related to the distribution network observability area and to the SGUs within its control area. The technical requirements should where possible, be in accordance with an international standard recommended by all TSOs and with current technologies to guarantee security, confidentiality and redundancy of the communications.
4. Each TSO, when exchanging real time information with other TSOs, shall follow and fulfil all the rules and obligations according to the current all TSOs practices in terms of:
 - a. logical connections between parties and protocols used;
 - b. network architecture including redundancy;
 - c. network security rules;
 - d. identification code (ID) and/or naming convention and data quality;
 - e. data transmission parameters and performance; and
 - f. rules of conduct in the case of planned outages and disturbances of communication equipment.
5. Each TSO shall define the refresh rate for the real-time data exchanges in its control area. It shall not be longer than 1 minute.

Chapter 2 Responsibilities of DSOs

Structural data

Article 11

Notification of changes

1. Each DSO shall review the structural information of its network elements that form the observability area of its TSO and of the SGUs connected to those network elements at least every 6 months. Each DSO shall provide updated information to the TSO as defined at a national level or, if it's not defined at a national level, in the following situations, however in both cases not less than 3 months before:
 - a. the planned commissioning of a new network element or SGU;
 - b. the planned final removal from service of the network element or SGU; and
 - c. the planned significant modifications in the network element or SGU.

Moreover, DSOs shall provide updated information as soon as possible in case there is a change in the observability area and as soon as an error in the data set transmitted earlier is detected.

2. Each DSO, in coordination with TSOs and SGUs, shall specify the format and may publish templates for the structural data that distribution connected SGUs that exchange directly data with the DSO shall provide. The format or template has to include the detailed content of the structural data to be provided. In addition, in the case SGUs send the data both to the TSO and DSO, for efficiency and consistency reasons, the specified format should be, to the extent possible, the same as the one specified by TSOs according to Article 7(2) of KORRR.
3. According to Article 5(4), SGUs connected at the distribution level may request the update of the structural data from its DSO.

Scheduled data

Article 12

Rights and responsibilities of DSOs

1. According to Article 72 of the SO GL, each TSO shall perform security analyses at several timeframes using its compulsory observability area calculated in Article 75 of the SO GL. Therefore, all DSOs within the observability area of the relevant TSO shall provide to the TSO their planned unavailability of network elements for the timeframes listed in Article 72(1) of the SO GL and their unplanned unavailability as soon as possible. For planned unavailability, they shall agree on the necessary level of coordination and communication between them. Transmission connected DSOs shall provide data directly to the TSO. Non-transmission connected DSOs may provide data directly to the TSO or through its connecting DSO or to both, as defined in Article 3(3) of KORRR. The frequency of delivery of scheduled data shall be defined at a national level.
2. Each DSO shall have access to the scheduled data of SGUs connected to its network. DSOs shall comply with the requirements defined by the relevant TSO to exchange scheduled data.

Real Time data

Article 13

Real Time Data provided by DSOs

1. Each DSO shall provide to its TSO real time data from the observability area defined by the TSO according to Article 44 of the SO GL.
2. Each DSO shall fulfil the requirements defined by the TSO in terms of:
 - a. logical connections between parties and protocols used;
 - b. network Architecture including redundancy;
 - c. network security rules;
 - d. identification code (ID) and/or naming convention and data quality;
 - e. data transmission parameters and performance; and

- f. rules of conduct in the case of planned outages and disturbances of communication equipment.

Chapter 3 **Responsibilities of SGUs**

Structural data

Article 14

Structural Data provided by SGUs

1. Each SGU connected to the transmission system shall provide to its TSO the structural data according to Articles 45 and 52(1) of the SO GL in the format specified by its TSO.
2. Each SGU connected to the distribution system shall provide directly to the TSO or through its connecting DSO or to both, as defined in Article 3(3), the structural data according to Articles 48 and 53 of the SO GL in the format specified by its TSO or DSO.

Article 15

Notification of changes

1. Each SGU shall review the structural information it shares with the DSOs or TSOs of the control area the SGU belongs to, at least every 6 months. Each SGU shall provide updated information to the TSO and/or DSO as defined at a national level or, if it's not defined at a national level, in the following situations, however in both cases not less than 3 months before:
 - a. the planned commissioning of a new network element or SGU;
 - b. the planned final removal from service of the network element or SGU; and
 - c. the planned significant modifications in the network element or SGU.

Moreover, each SGU shall provide updated information as soon as an error in the data set transmitted earlier is detected and in case of an unforeseeable modification, the SGU shall inform the TSO without delay.

Scheduled data

Article 16

Scheduled Data provided by SGUs

1. All SGUs within the control area of the TSO shall provide scheduled data to the TSO. Transmission connected SGUs shall provide data directly to the TSO. Distribution connected SGUs shall provide data directly to the TSO or through its connecting DSO or to both, as defined in Article 3(3) of KORRR.
2. SGUs shall comply with the requirements defined by the relevant TSO, and/or by the DSO when the SGU is required to provide data through the DSO according to Article 3(3) of KORRR, to exchange scheduled data. The frequency of delivery of scheduled data shall be defined at a national level.

Real Time data

Article 17
Real Time Data provided by SGUs

1. Subject to Article 6(5) of KORRR, all concerned SGUs connected to the transmission system shall provide the real-time data directly to the TSO. Subject to Article 6(5) of KORRR, all concerned distribution connected SGUs shall provide the real-time data to the TSO directly or through its connecting DSO or to both, as defined in Article 3(3). All SGUs which are power generating modules not subject to the NC RfG, or which are HVDC systems not subject to the NC HVDC, or which are demand facilities not subject to the NC DCC, shall inform to the TSO about their technical capabilities for real time data provision. The evaluation process to exempt particular SGUs, in case of non-compliance with the requirement to provide real time data, shall be defined at a national level.
2. Each SGU providing data directly to the TSO or the DSO when the data is directly provided to the DSO shall fulfil the requirements defined by the TSO in terms of:
 - a. logical connections between parties and protocols used;
 - b. network architecture including redundancy;
 - c. network security rules;
 - d. identification code (ID) and/or naming convention and data quality;
 - e. data transmission parameters and performance;
 - f. rules of conduct in the case of planned outages and disturbances of communication equipment.

TITLE 3
Final provisions

Article 18
Implementation date of the KORRR

1. Upon approval of the KORRR each TSO shall publish it on the internet in accordance with Article 8(1) of the SO GL.
2. By 18 months after entry into force of the SO GL, and in accordance with Article 192 of the SO GL, TSOs shall apply the KORRR as described in Title 2 as soon as all regulatory authorities have approved the KORRR or a decision has been taken by the Agency in accordance with Article 6(8) and 7(3) of the SO GL.

Article 19
Language

The reference language for the KORRR shall be English. For the avoidance of doubt, where TSOs need to translate the KORRR into their national language(s), in the event of inconsistencies between the English version published by TSOs in accordance with Article 8 (1) of the SO GL and any version in another language,

the relevant TSOs shall, in accordance with national legislation, provide the relevant national regulatory authorities with an updated translation of the KORRR.

**SUPPORTING DOCUMENT TO ALL TSOS'
PROPOSAL FOR THE KEY ORGANISATIONAL
REQUIREMENTS, ROLES AND
RESPONSIBILITIES (KORRR) RELATING TO
DATA EXCHANGE**

09.10.2018

1.	PURPOSE AND OBJECTIVES OF THE SYSTEM OPERATION GUIDELINES.....	3
2.	PURPOSE AND OBJECTIVES OF KORRR	3
2.1	LEGAL STATUS	4
2.2	GENERAL PRINCIPLES	5
2.3	RELATION WITH SO GL:	10
A.	INTERPRETATION OF ARTICLES 40(5) AND 40(7)	10
B.	INTERPRETATION OF ARTICLE 7.2 AND 11.2	12
2.4	RELATION WITH OTHER NETWORK CODES AND GUIDELINES.....	12
2.4.1	Relation with Network Code on Requirements for Generators.....	12
2.4.2	Relation with Network Code on Demand Connection	13
2.4.3	Relation with Network Code on Emergency and Restoration.....	14
2.4.4	Relation with Guideline Forward Capacity Allocation.....	14
2.4.5	Relation with Network Code on High Voltage Direct Current Connections and DC connected Power Park Modules	15
2.4.6	Relation with guideline on Capacity Allocation and Congestion Management.....	15
2.4.7	Relation with guideline on Electricity Balancing.....	16
2.5	RELATION WITH OTHER METHODOLOGIES	17
2.5.1	Relation with Generation and Load Data Provision Methodology	17
3.	RESULTS FROM THE SURVEY OF DATA EXCHANGE FOR ENTSO-E MEMBERS	17
3.1	SCOPE	18
3.2	LEVEL OF DETAIL.....	20
4.	PROVISIONS OF THE KORRR	21
4.1	STRUCTURAL INFORMATION	21
4.2	SCHEDULED INFORMATION.....	22
4.3	REAL TIME INFORMATION.....	23
5.	REFERENCES	24
6.	ASSESSMENT OF THE KORRR AGAINST ARTICLE 40(6)	26

1. PURPOSE AND OBJECTIVES OF THE SYSTEM OPERATION GUIDELINES

European Network of Transmission System Operators for Electricity (hereinafter referred to as “ENTSO-E”) drafted the Commission Regulation (EU) 2017/1485 guideline on electricity transmission system operation (hereinafter referred to as “SO GL”) to set out clear and objective minimum requirements for Operational Security and achieving the main goal of keeping the European interconnected Transmission Systems in continuous operation, in order to contribute to a harmonised framework for completion of the EU Internal Electricity Market (IEM) and to ensure non-discrimination, effective competition and the efficient functioning of the IEM.

Based on the SO Framework Guideline and on the Initial Impact Assessment provided by ACER, the SO GL states the Operational Security principles in terms of technical needs, considering market solutions compatible with and supporting security of supply.

2. PURPOSE AND OBJECTIVES OF KORRR

This document has been developed by the ENTSO-E to accompany the Key Organizational Roles, Requirements and Responsibilities (hereinafter referred to as “KORRR”) and should be read in conjunction with that proposal.

It aims to provide interested parties with information about the rationale for the approach set out in the KORRR, outlining the reasons that led to the requirements specified in it.

The content of the KORRR document is created based on the scope for the methodology specified in article 40(6) of SO GL. The wording of the article is:

*By 6 months after entry into force of this Regulation, all TSOs shall jointly agree on key organisational requirements, roles and responsibilities in relation to data exchange. Those organisational requirements, roles and responsibilities shall take into account and complement where necessary the operational conditions of the generation and load data methodology developed in accordance with Article 16 of Regulation (EU) No 2015/1222. **They shall apply to all data exchange provisions in this Title and shall include organisational requirements, roles and responsibilities for the following elements:***

- a) *Obligations for TSOs to communicate without delay to all neighboring TSOs any changes in the protection settings, thermal limits and technical capacities at the interconnectors between their control areas;*
- b) *Obligations for DSOs directly connected to the transmission system to inform their TSOs, within the agreed timescales, of any changes in the data and information pursuant to this Title;*
- c) *Obligations for the adjacent DSOs and/or between the downstream DSO and upstream DSO to inform each other within agreed timescales of any change in the data and information established in accordance with this Title;*
- d) *Obligations for SGUs to inform their TSO or DSO, within agreed timescales, about any relevant change in the data and information established in accordance with this Title;*
- e) *Detailed content of the data and information established in accordance with this Title, including main principles, type of data, communication means, format and standards to be applied, timing and responsibilities;*
- f) *The time stamping and frequency of delivery of the data and information to be provided by DSOs and SGUs, to be used by TSOs in the different timescales. The frequency of*

information exchanges for real-time data, scheduled data and update of structural data shall be defined; and

- g) *The format for the reporting of the data and information established in accordance with this Title.*

The purpose of the KORRR is to define organizational requirements, roles and responsibilities regarding points a) to g), this means that the KORRR shall address how the exchange of information shall be and who shall define the details of that exchange of information, not to define specifically the details for each of those points.

Main added value of the KORRR is to define a general framework to organize the exchange of information between the different parties involved in the security of the electric system. The KORRR will address the organization of the data exchange so each party can get the necessary data to have observability of the part of the network with impact in their facilities to comply with the requirements defined in the SO GL.

2.1 LEGAL STATUS

Legal considerations of KORRR

The development of this document has been done within ENTSO-E, as the primary delivery body for the coordinated proposals relating to the implementation of the network codes. However, as the scope of TSOs required to produce it goes beyond membership those additional parties have also been included during internal review and approval.

The responsibility of providing data remains in the owner of the facility, even when it would be possible to delegate the task of providing the information. The responsibility of ensuring confidentiality remains with the collecting party. However, all data that is required to be shared under SO GL or any other legislation is then subsequently expected to also be covered under the respective confidentiality clauses of such a legislation. When data is required to be provided to the respective National Regulatory Authority (hereinafter referred to as "NRA") for the purposes of compliance monitoring the responsibility for such data provision is expected to be done directly on a national basis.

Many parties referred to in SO GL and subsequently within the KORRR are by the generic term used within the scope article 2(1) of SO GL. However, it is acknowledged that other designations for similar parties with similar or overlapping roles may exist, e.g. TO, DNO etc. When possible, additional guidance will be given on the inclusion or application of these requirements on such parties. However, the overarching expectation is that the respective member state will determine the correct interpretation and application of these responsibilities on other parties.

The development of the KORRR is done according to the requirements from SO GL. It establishes responsibilities to transmission system operators (TSOs), distribution system operators (DSOs), closed distribution system operators (CDSOs) and significant grid users (SGUs).

Those TSOs from countries not members of the European Union are not directly bound by this methodology. It needs to be reflected in the wording of the KORRR the possibility for those TSOs to join the methodology in a voluntary basis.

Network Codes (hereinafter referred to as “NC”) shall apply at ENTSO-E level and replace former UCTE Operational Handbook. When it is necessary to reach agreements at Synchronous Area level, a Synchronous Area Operational Agreement (SAOA) will be formalized.

Legal status of the Supporting Document

This document accompanies the KORRR and is provided for information purposes. Consequently, this document has no legally binding status.

2.2 GENERAL PRINCIPLES

SO GL defines the tasks and responsibilities that TSOs shall fulfil to safeguard Operational Security in Normal State and Alert State. Responsibilities in Emergency, Blackout and Restoration system state are defined in Regulation (EU) 2017/2196 Network Code on Emergency and Restoration (NC ER).

The content of the SO GL is divided into three main parts with technical requirements as follows:

Part II – Operational Security (OS) requirements of the SO GL deal with detecting system states, frequency control, voltage control, short-circuit current, power flows, contingency analysis, protection, dynamic stability limits.

Part III – Operational Planning and Scheduling (OPS) requirements of the SO GL deal with data for operational security analysis in operational planning, Operational security analysis, Outage coordination, System adequacy, ancillary services, operational scheduling, as well as the specifications for the ENTSO provided platform for Electricity operational planning data environment (OPDE).

Part IV – Load-Frequency Control and Reserves (LFCR) of the SO GL deal with Operational agreements, Frequency quality, Load-frequency control structure, Operation of load-frequency control, frequency containment reserves (FCR), frequency restoration reserves (FRR), replacement reserves (RR), exchange and sharing of reserves, time control process, co-operation with DSOs and transparency of information.

To be able to carry out the provisions of System Operation Guideline, TSOs needs a crisp and clear status of the system. A crisp and clear status can only be obtained with an adequate exchange of information between the parties involved in keeping the stability of the system.

Stakeholders considered to be significant for the system stability are the following:

- TSO of the control area, control block;
- Neighbouring TSOs;
- DSOs within the control area, control block;
- CDSOs within the control area, control block;
- SGUs in the control area, including both generator and demand facilities according to article 2(1) of SO GL.

The information exchanged shall be adequate to have accurate representations of the status of the electric system in the different timeframes covered by the SO GL, from year-ahead to real time.

In SO GL Part II, Title 2 - Data exchange, the three main categories of information to be considered in the information exchange are:

- **Structural information:** includes all the general and permanent characteristics and attributes of the facility and represents the capabilities of the equipment and is necessary to prepare static and dynamic models of the facilities;
- **Scheduled information:** represents the expected behaviour of the facilities and networks elements in the scheduled time frame and near future, considering near future up to one year according to provisions of SO GL. It includes information related to outage planning and generation/ consumption schedules;
- **Real time information:** represents the present behaviour of the facility.

To perform security analysis in real time and thereby, secure operational security limits in the present, a combination of the structural and the real-time information is compulsory. To be able to reach real time safely, security analysis need to be performed in advance. Structural and scheduled information is needed to prepare cases with the expected situation on the system in the near future.

The objective of the KORRR is to define common rules at European Union (EU) level to address the exchange of the required information between the significant stakeholders of the European electricity system.

To complement this explanation, chapter 6 of “Supporting Document for the Network Code on Operations Security” can be consulted.

Level of Detail

Data exchanged following SO GL shall be the necessary one to perform security analysis and guarantee operational security in the Electric System. Regulation shall achieve a certain level of harmonization between ENTSO-E members and also allow flexibility for future developments. Title 2 of SO GL currently achieves harmonization addressing the required exchange of information without defining all details. Stablishing a specific level of detail in European regulation will be too tight and inflexible because it will need long times to adapt if new developments or requirements of the system appear.

In line with this, to allow national or regional specificities, as the KORRR shall not define the detailed information to be exchanged between TSOs and significant stakeholders but shall establish the responsibilities at a national level of **who shall define** and approve the detailed information to be exchanged.

In the end, horizontal TSO-TSO, harmonization shall be reached, adopting ENTSO-E proposal for applied international standards, leaving flexibility for vertical TSO-DSO and TSO-SGU exchange of information, to be defined at a national level. In this case, the KORRR shall refer to who defines the exchange of information.

Reciprocity

Title 2 of SO GL provides the framework for the exchange of information between TSOs and the other significant stakeholders of the System to safeguard Operational Security. To achieve it, each agent in the system shall be able to gather the necessary information to comply with the tasks defined by SO GL. Articles 40(8), 40(9) and 40(10) of SO GL consider and regulate the exchange of information from TSOs to DSOs and/or SGUs. In this sense, the KORRR needs to consider bidirectional flows of information between all affected parties and takes it into account in the articles related to confidentiality and accessibility of data.

The TSOs:

- as responsible for balancing shall gather information from SGUs connected both at Transmission and Distribution level.
- as Transmission Network Operators shall gather information from
 - o SGUs connected at Transmission level and
 - o DSOs regarding Observability Area in the distribution network.
 - o Neighbouring TSOs regarding Observability Area in the neighbour Transmission Systems

The DSOs and CDSOs, as Distribution Network Operators shall gather information from:

- SGUs connected to distribution level and
- TSOs regarding their Connection Point(s) in the Transmission System and other assets with relevance for their network
- Neighbouring DSOs

The SGUs gather information from:

- TSOs regarding their Connection Point when they are connected to the transmission system or
- DSOs regarding their Connection Point when they are connected to the distribution network
- Instructions from TSOs regardless of the SGU Connection Point.

Significant Grid Users

The KORRR includes organizational requirements, roles and responsibilities of all the parties involved in the interconnected networks operation: TSO, DSO, SGUs. In particular, according to article 2 of SO GL, the list of the SGUs is the following:

- existing and new power generating modules classified as type B, C and D;
- existing and new transmission-connected demand facilities;
- existing and new transmission-connected closed distribution systems;
- existing and new demand facilities, closed distribution systems and third parties if they provide demand response directly to the TSO;
- providers of re-dispatching of power generating modules or demand facilities by means of aggregation and providers of active power;
- existing and new high voltage direct current (HVDC)

The Grid Users included in the previous list shall provide data to DSOs and TSOs; and they are responsible for the data and its modifications. SGUs are the owners of the information from their

facilities or the services they provide to the System so they are responsible for that information. Indirect exchange through a third party, for example Balancing Service Provider (BSP) or Balance Responsible Party (BRP), shall be allowed but the final responsibility of the exchange and quality of the information shall rely always in the owner of the facility.

Distribution connected facility: Article 2 of SO GL defines significant grid users as used in the guideline. SGU Demand is defined in Art d) and e). Demand facilities can only be SGU if they are directly connected to the Transmission System or they provide demand response directly to the TSO or if they provide re-dispatching with their facility. This definition ensures that households or very small loads won't be considered in the SO GL.

When a grid user is qualified to provide services to the system, it becomes a SGU and it will have to fulfil the requirements settled in the SO GL, the KORRR or any other relevant European regulation. Regarding Data Exchange, once a grid user is considered significant, it will have to comply with the requirements of the proposal: communications, infrastructures, quality... In those occasions where the SGU is also providing services, then it will have also to provide the data to the system operator. In the occasions where the SGU is not providing services, it may not be obliged to send data.

Clarity

The KORRR includes specific terms in order to describe the general data exchange in an appropriate detail level. All of the terms that are used are defined in the KORRR itself or in the SO GL. The following terms need a clarification as they were mention in the public consultation:

- Modification: the modification of a facility is defined as an event for sending updated structural data. Since a modification isn't clearly defined, the KORRR can be used for defining the term "modification of a facility". Significant modification is defined in the NC RfG, def. 65. The national implementation of the connections codes shall be also considered.
- The term "Logical connection" is used to indicate the way that the data flows through the network from one device to the next without regard to the physical interconnection of the devices.
- The expression "Rules of conduct" is used to indicate the procedures used in example in the following cases:
 - o event in the communication: if the principal link is lost, it's necessary to use the second one, if the second also fails it's necessary to use the email, if it also fails it's necessary to use the telephone...
 - o planned outages of the communication link: to inform in advance the parties who receive the data specifying the timing and the possible consequences for the data exchange

Flexibility

One concern regarding flexibility of the KORRR are the various ways of creating the electrical simulation model of a facility may be provided, e.g. by equipment manufacturers, by facility owner, by design consultants. Definitely the responsibility for providing the complete electrical simulation model of a facility is on the shoulder of the facility owner requesting the grid connection.

Flexibility needs to cover at least the following two issues:

- What amount / scope of information to exchange, and,
- The format of that information exchange.

An example of the first aspect of flexibility is the information required to prepare static/ dynamic simulation models. Two opposite approaches can be considered:

- Simulation models to be provided to the TSO as a whole to be directly used for simulations;
- Necessary parameters to be provided to allow TSOs to build the simulation models to be used in simulations of the national grid system.

Either approaches or an intermediate one can be considered at national level. The KORRR does not prescribe neither of them.

For small scale facilities, e.g. main components of type B facilities the electrical simulation model be required as a part of the equipment certificate according to EU 2016/631 (NC RfG) Art. 2 (47). If a member state (NRA) wants to prepare the notification process in an efficient manner, a “positive list” of main components could be created with the pre-approved components included, but this is solely up to the member states to decide.

For large scale facilities, e.g. type C and D facilities the electrical simulation model of the key components could be provide directly to the relevant TSO if required in order to keep track of confidentiality. Still the responsibility for providing the complete electrical simulation model of a facility is on the shoulder of the facility owner requesting the grid connection

Another essential issue of interest for the stakeholder is the big variation in the current applied information exchange practices between the member states. It’s recommended to the TSOs to keep the flexibility in the implementation within its own control area: DSOs and SGUs; and secure a knowledge sharing across the European electricity market in this aspect. This is foreseen to be reflected in the KORRR based on open wording in order to allow flexibility for different practices in different countries.

This will affect how the information is exchanged between the TSO and the SGUs, e. g. directly or indirectly information exchange through the DSO. Each TSO may have different templates for structural information within its control area depending on the impact on the transmission capacity. Even if the double provision is considered the default option, different paths for the information to be exchanged may be coordinated at national level in order to avoid exchange of duplicated information. The same issues will be on scheduled and real-time information.

Different TSOs and DSOs may have different templates for structural, scheduled and real-time information which will be respected to the outmost extend where possible.

2.3 RELATION WITH SO GL:

a. INTERPRETATION OF ARTICLES 40(5) AND 40(7)

Articles 48 to 50 and 53 of the SO GL relates to the exchanges of information between TSOs, DSOs and SGUs connected to the distribution network states that SGUs shall provide data both to the TSO and the DSO they are connected to. The KORRR in article 3(2), in line with it renders it as a default option. This exchange of data can be done by the SGUs through a third party like a control centre, an aggregator or any other entity considered in the national implementation of the network codes.

Default Option

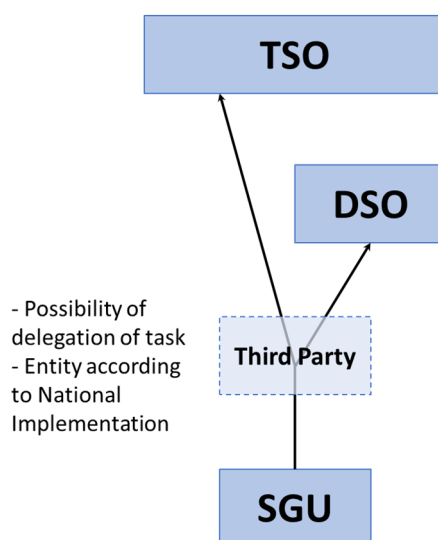


Figure 1. The arrows represent the data related to distribution connected SGUs

In order to facilitate the exchange of data and reduce the costs of SGUs, the KORRR in article 3(3) reflects the possibility that it can be determined at a national level whether an SGU sends the data to TSO or DSO and it is subjected to NRA approval. When it is the case, to ensure that both the TSO and the DSO to whose network the SGU is connected have the necessary data, system operators have to exchange between them the data related to the SGU. This has to be done according to the processes to exchange data between TSO and DSO agreed according to article 40(7) of the SO GL. European resolution on 19th December could also establish a work direction at a national level.

Application of Article 40(5)

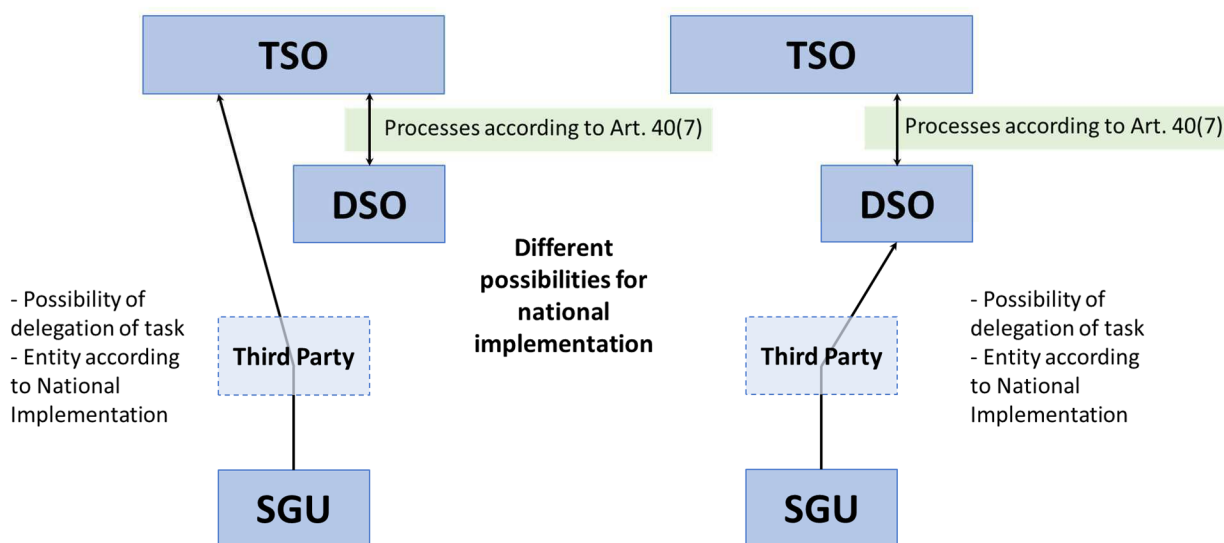


Figure 2. The arrows represent the data related to distribution connected SGUs

Provision of data by SGUs connected to distribution grids to TSOs can be implemented according to of the following three options:

- 1) TSOs could have access to the required data from a distribution connected SGU through an aggregator or balancing service provider (BSP).
In many cases, the aggregator or BSP have direct contact with the plant, for example, for bidding in the day-ahead and intraday markets or for issuing instructions to balance their portfolio. The same communication channel from the plant to the aggregator or BSP that is used for participating in the wholesale markets or internal BRP or BSP management may be used for participating in the balancing markets or for other system services like congestion management. In this case, the data can also be sent from the TSOs to the connecting DSO when it is needed to perform the DSO tasks. This option is considered under paragraph 3 (7) of KORRR in which SGUs delegate part of their tasks to a third party.
- 2) DSOs pass relevant data in an efficient and timely way to the TSO. One option is for the DSO to create direct access to this data via their SCADA systems.
If DSOs have direct contact and receive directly individual real-time data collected at the point of connection, another implementation option may be that DSOs send the data to TSOs.
- 3) TSOs could also be able to have access to distribution connected SGUs through a direct technical solution of the TSO.
The TSO may also access the individual data of the SGU by collecting it directly at the point of connection. This option requires higher communication needs and access to the point of connection in the DSO network by the TSO.

It has to be clarified, that the KORRR national implementation should not be reduced to the three possibilities mentioned before, there will be other possibilities for exchanging data. For example, the case where SGUs enters the data on a common platform to which both TSO and DSO have access to.

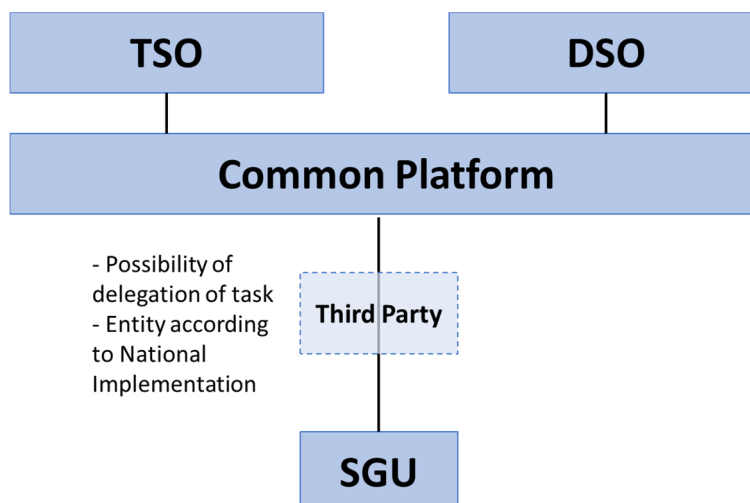


Figure 3. The arrows represent the data related to SGUs that could be share in a common platform

b. INTERPRETATION OF ARTICLE 7.2 AND 11.2

Article 7.2 establishes an agreement, Art.40 (7), between TSOs and DSOs regarding SGUs' templates. This agreement should be limited to the relevant DSOs, meaning the involved ones, which are affected by the format of the template. In the case any DSO is not involved, the TSO can specify the template in coordination with the SGU.

2.4 RELATION WITH OTHER NETWORK CODES AND GUIDELINES

2.4.1 Relation with Network Code on Requirements for Generators

(Official Journal of the European Union – 14/04/16)

General requirements

Not included.

Structural data

Article 14 defines the information exchanges of type B modules. Type B power-generating modules shall fulfil the following general system management requirements with regard to information exchange: the relevant system operator, in coordination with the relevant TSO, shall specify the content of information exchanges including a precise list of data to be provided by the power-generating facility.

Article 32 and 35 define the data exchange regarding the power-generating module document (PGMD) within the notification procedure. The format of the PGMD and the information to be given therein shall be specified by the relevant system operator. The relevant system operator shall have the right to request that the power-generating facility owner include the following in the PGMD: detailed

technical data of the power-generating module with relevance to the grid connection as specified by the relevant system operator.

Article 41 defines the tasks of the relevant system operator regarding compliance monitoring. The system operator shall make publicly available a list of information and documents to be provided. The list shall cover at least the following information, documents and requirements: details of the technical data on the power-generating module of relevance to the grid connection.

Article 43 defines the data exchange regarding the compliance simulation. The relevant system operator shall provide the power-generating facility owner with technical data and a simulation model of the network.

Scheduled Data

Scheduled data is not included.

Real time data

Article 14 defines the basic capability of power generating modules regarding real time data exchange. Type B power-generating modules shall be capable of exchanging information with the relevant system operator or the relevant TSO in real time or periodically with time stamping, as specified by the relevant system operator or the relevant TSO.

2.4.2 Relation with Network Code on Demand Connection

(Official Journal of the European Union – 17/08/16)

General requirements

Article 18 defines the general requirements regarding the information exchange in terms of compliance to the standards and time stamping specified by the relevant TSO.

Structural data

Article 14 defines the information exchanged regarding the short-circuit current. The relevant TSO shall provide the transmission-connected demand facility owner or the transmission-connected distribution system operator an estimate of the minimum and maximum short-circuit currents to be expected at the connection point. TSO shall request information from a transmission-connected demand facility owner or the transmission-connected distribution system operator concerning the contribution in terms of short-circuit current.

Article 21 defines the requirements regarding the simulation models. Each TSO may require simulation models or equivalent information showing the behaviour of the transmission-connected demand facility owner or the transmission-connected distribution system operator. Content and format of simulation models or equivalent information shall be specified by each TSO.

Article 24 and 25 regarding to the interim operational notification and the final operation notification define additional information may be requested by TSO in terms of technical data, simulation models and studies.

Demand units within a demand facility or a closed distributions system connected at a voltage level of or below 1kV have to provide an installation document including technical data (Article 32).

Scheduled Data

Scheduled data is not included.

Real time data

Real time data is not included.

2.4.3 Relation with Network Code on Emergency and Restoration

(Official Journal of the European Union – 28/11/17)

General requirements

No general requirements.

Structural data

Structural data exchange is not included.

Scheduled Data

Scheduled data exchange is not included.

Real time data

Real time data exchange is not included.

2.4.4 Relation with Guideline Forward Capacity Allocation

(Official Journal of the European Union – 26/09/16)

General requirements

According to article 17 of the FCA GL, no later than six months after the approval of the GLDPM established for CACM GL, all TSOs shall jointly develop a proposal for a single GLDPM for delivering the generation and load data required to establish the common grid model for long-term time frames. The KORRR shall take into account and complement the GLDPM according to Article 16 of CACM GL.

Structural data

Structural data exchange is included in the GLDPM version 2 according to article 17.

Scheduled Data

Scheduled data exchange is included in the GLDPM version 2 according to article 17.

Real time data

Real time data is not included.

2.4.5 Relation with Network Code on High Voltage Direct Current Connections and DC connected Power Park Modules

(Official Journal of the European Union – 26/08/16)

General requirements

Not included

Structural data

If requested by TSOs, HVDC owners shall perform studies to demonstrate that no adverse interaction (for instance Sub-synchronous torsional interaction) may occur. The HVDC System Owner shall provide the TSO all relevant data and models (Articles 29, 31). TSO can require the HVDC System Owner to deliver simulation models which properly reflect the behaviour of the HVDC System in both steady-state, dynamic simulations (fundamental frequency component) and in electromagnetic transient simulations. TSO shall define the format in which models shall be provided (Article 54).

The Relevant Network Operator shall define and provide the method and the pre-fault and post-fault conditions for the calculation of at least the minimum and maximum short circuit power at the Connection Point (Articles 32, 42).

Technical data, models of the HVDC and studies shall be provided by HVDC owners and DC-connected Power Park Modules with the Interim Operational Notification (ION) and Final Operational Notification (FON) (Articles 57, 58, 62, 63).

Scheduled Data

Scheduled data is not included.

Real time data

Real time data is not included.

2.4.6 Relation with guideline on Capacity Allocation and Congestion Management

(Official Journal of the European Union – 24/07/15)

General requirements

According to Article 16, no later than 10 months after the entry into force of this Regulation all TSOs would have had to develop a proposal for a single methodology for the delivery of the generation and load data required to establish the common grid model (GLDPM).

Structural data

Structural data exchange is included in the GLDPM.

Scheduled Data

Scheduled data exchange is included in the GLDPM.

Real time data

Real time data is not included.

2.4.7 Relation with guideline on Electricity Balancing

(Official Journal of the European Union – 18/18/17)

General requirements

No general requirements.

Structural data

Requirements for data exchange specific for the balancing services: defined at European level for the exchange of balancing services between TSOs and at national level for the pre-qualification tests.

Scheduled Data

Requirements for data exchange specific for the balancing services: defined at European level for the exchange of balancing services between TSOs and at national level for the pre-qualification tests and evaluation of the provision of balancing services.

Real time data

Requirements for data exchange specific for the balancing services: defined at European level for the exchange of balancing services between TSOs and at national level for the pre-qualification tests and evaluation of the provision of balancing services.

2.5 RELATION WITH OTHER METHODOLOGIES

2.5.1 Relation with Generation and Load Data Provision Methodology

(Official Journal of the European Union – 24/07/15)

Generation and Load Data Provision Methodology (GLDPM) sets out the generation and load data which may be required by TSOs in order to establish the common grid model.

The methodology specifies:

- which generation units and loads are required to provide information to their respective TSOs for the purposes of capacity calculation: Distribution and closed distribution system operators, generation, load, HVDC links
- the information to be provided by generation units and loads to TSOs: structural data, infrequently changing variable data, variable data (Articles 5-15)
- the deadlines applicable to generation units and loads for providing the information (Article 16)

The KORRR and the GLDPM are related because both refer to the exchange of data between TSOs, DSOs and SGUs but they do not have the same purpose.

The GLDPM was developed following the two market codes CACM and FCA. The purpose is to have the data from relevant loads of generators that are cross-border relevant and may have impact at Capacity Calculation Region level. So, the affected loads and generators are the biggest ones connected to the higher voltage level. Application of this methodology is voluntary in the Member States.

The KORRR is developed following the Operational SO GL. The purpose is to allow TSOs, DSOs and SGUs to access the data to guarantee system security. Opposing to the GLDPM, the KORRR is not voluntary and it applies to all SGUs as defined in article 2(1) of the SO GL and revised at national level according to article 40(5). This means that it affects more users than the GLDPM, not only the biggest ones. The purpose of the KORRR is to be compatible with the GLDPM setting similar or more flexible requirements than the GLDPM. This way, the smaller grid users may have the same or more flexible requirements than the biggest ones and grid users sending data according to the GLDPM would comply also with the KORRR.

3. RESULTS FROM THE SURVEY OF DATA EXCHANGE FOR ENTSO-E MEMBERS

A questionnaire has been prepared by the project team and sent out to TSOs. This section provides a summary of the answers, reflecting the current practice in data exchange for more than a half of ENTSO-E members.

Note that because multiple answers were possible, the percentages do not necessarily sum up in 100% in the results interpretation below.

Main requirements for information exchanges (structural, schedule and real-time) are imposed by NRA-s (in more than 90% answers) or other non-ENTSO-E methodologies (+71%). ENTSO-E methodologies at present have the highest representation for schedule data (71% of respondents), and for structural and real-time data the representation is only in slightly over 50% of respondents.

Although NRAs mainly prescribe the requirements, information exchange does not flow through the NRA, except in seldom cases: one TSO reported to exchange Market information with their SGUs through the NRA, on intraday and daily basis and one country will implement in 2017 a process to exchange Structural information through NRAs.

3.1 SCOPE

	Structural Information	Scheduled information	Real Time information
Neighbouring TSOs	92 %	88 %	92 %
DSOs/ CDSOs	96 %	63 %	63 %
Transmission Connected SGU	96 %	92 %	92 %
Distribution Connected SGU	63 %	58 %	71 %
Ancillary Services Providers	76 %	71 %	88 %
NEMOs	17 %	71 %	17 %

Table 1: System agents that exchange information with the TSOs

Regarding structural information, most data is exchanged with those directly connected to the Transmission System: DSOs/ CDSOs (96 %), Transmission Connected SGU (96 %) and Neighbouring TSOs (92 %). It is also important the number of TSOs that exchange structural information with other agents not directly connected to the Transmission System: Distribution Connected SGU (63 %) and Ancillary Services Providers (75 %). For this type of information, NEMOs (17 %) are not very representative.

Real Time Information Exchange have a similar pattern to structural information. Almost all TSOs deal with Neighbouring TSOs (92 %), Transmission Connected TSOs (92 %) and DSOs/CDSOs (83 %). In this case, the number of TSOs that share information with Ancillary Services Providers (88 %). NEMOs (17 %) are also little represented.

The importance of NEMOS is increased in case of Scheduled Information (71 %). On the other hand, the number of TSOs exchanging scheduled information with DSOs/CDSOs is lower (63 %). Neighbouring TSOs (88 %), Transmission Connected SGU (92 %) and Ancillary Services Providers (71 %) keep similar values to Structural Information.

	Direct Exchange with SGU Generator	Direct Exchange from SGU Demand	Direct exchange from DSO	Exchange through DSO from SGU
Before 1 st Commissioning	100 %	83 %	75 %	54 %

Final Removal from service	96 %	79 %	71 %	50 %
Modification of the Facility	96 %	83 %	75 %	46 %
Correction of Errors	88 %	71 %	63 %	38 %
Periodic	29 %	21 %	25 %	29 %

Table 2: Criteria/ frequency to exchange structural data

Structural information is exchanged by TSOs at least in five identified cases. This flow of information can happen directly with the owners of the information or through the operator of the network where the agent is connected. Most TSOs directly share information in some cases with SGU and DSOs. This is especially true when they are directly connected to the Transmissions System. On the contrary, only half of the TSOs share the information with Distribution Connected SGU through DSOs.

		Direct Exchange with SGU Generator	Direct Exchange from SGU Demand	Direct exchange from DSO	Exchange through DSO from SGU	Exchange through NEMO from SGU
Outage Planning	Over Year	66 %	29 %	29 %	0 %	8 %
	Yearly	96 %	58 %	58 %	21 %	13 %
	Monthly	58 %	42 %	38 %	13 %	13 %
	Weekly	54 %	38 %	42 %	8 %	13 %
	Other	17 %	8 %	4 %	4 %	4 %
	Event driven	88 %	54 %	63 %	13 %	8 %
Market	D-2	17 %	17 %	4 %	0 %	0 %
	Daily	88 %	58 %	29 %	21 %	29 %
	Intraday	58 %	42 %	13 %	8 %	25 %
	Hourly	54 %	38 %	17 %	8 %	4 %
	Below hour	38 %	25 %	13 %	4 %	8 %
	Other	8 %	8 %	0 %	0 %	0 %
	Event driven	71 %	38 %	29 %	8 %	4 %

Table 3: Criteria/ frequency to exchange scheduled data

Scheduled information can be divided in two parts depending on the time frame: Horizons over the week will be referred to as “Outage planning” and below the week as “Market”. All TSOs that

answered the questionnaire said that they have an information system to exchange scheduled information.

Outage planning

- Exchange of over one year scheduled information is mainly done with generators (67 %) and to some extent with SGU Demand (29 %) and DSOs (29 %) directly connected to the Transmission System.
- More important is the Yearly planning. Almost every TSO have this process with generators (96 %) and half of them with SGU Demand (58 %) and DSOs (58 %) directly connected to the Transmission System. In some cases, information from Distribution Connected SGU flows through DSOs (21 %) or NEMOs (13 %).
- Monthly and weekly coordination also takes place. Like in the case all cases, the closest coordination takes place with generators.
- In a few cases there are different time frames to the ones mentioned in the questionnaire.
- Quite usual is the event driven exchange of information, taking place whenever a defined situation happens. There can be many different situations, for example, a change in the data.

Market

- Information exchanged in D-2 is reduced;
- With Daily market, the interlocutors of TSOs is much higher. Most Generators directly exchange with TSOs (88 %) and also SGUs (58 %). Not so frequent is to do the process directly with the DSO (29 %), through the DSO (21 %) or the NEMO (29 %).
- In the intraday market, the amount of energy is smaller and so is the exchange of information. Still, there is some information that flows through NEMOs.
- Hourly and below hour exchanges of information take place with similar distributions but the participation of NEMOs as these services are usually operated by the System Operator.
- In a few cases there are different time frames to the ones mentioned in the questionnaire.
- Quite usual is the event driven exchange of information, taking place whenever a defined situation happens. There can be many different situations, for example, a change in the data.

3.2 LEVEL OF DETAIL

In the questionnaire, we have provided three levels of detail for information exchanged with definitions as follows:

- Overall information (OI): Low level of detail. Models might not be developed with that information so they shall be provided apart;
- Detailed for further processing (DF): Medium level of detail. Further information would be necessary to develop all models; and,
- Very detailed (VD): High level of detail. It would allow to develop all models.

For exchange of structural information, most of respondents are currently exchanging it at levels VD (54%) or DF (33%). Even those that indicated mainly level OI exchange some part of information at higher levels of detail (e.g., for transmission connect at level VD, for distribution connected at level OI).

4. PROVISIONS OF THE KORRR

The KORRR organization can be seen as a matrix. At first, responsibilities of the different agents are grouped to make it easier to read for the different affected parties. Then, for each agent, chapters are grouped for each kind of information. The summary can be seen in the following diagram:

	General	Structural Data	Scheduled Data	Real Time data
Responsibilities of TSOs	Chapter 1			
	Art. 6	Art. 7, 8	Art. 9	Art. 10
Responsibilities of DSOs	Chapter 2			
	-	Art. 11	Art. 12	Art. 13
Responsibilities of SGUs	Chapter 3			
	-	Art. 14, 15	Art. 16	Art. 17

Figure 4: Aspects covered by each article of the KORRR

4.1 STRUCTURAL INFORMATION

Structural data include all the general and permanent information of the assets: characteristics, attributes, capabilities, etc. Structural data are necessary to prepare static and dynamic models of the facilities used to carry out static and dynamic security analysis.

All the parties involved have to exchange at least the list of information defined in SO GL.

The format of the structural data exchanged among TSOs is defined in the Common Grid Model Methodology (CGMM). At national level each TSO has to define the format and publish the templates to be used by DSOs and SGUs to provide structural data.

The update of the information is driven by the following events:

- new network element or facility;
- final removal from service of the network element or facility;
- significant modifications in the network element or facility;
- update of the observability area;
- error

All the data gathered by TSOs have to be stored in a data storage updated and maintained by TSOs. DSOs and SGUs can have access to the information referred to own facilities.

The following scheme summarizes the flow of information among all the parties involved. The reference to the articles of the KORRR is indicated in the scheme.

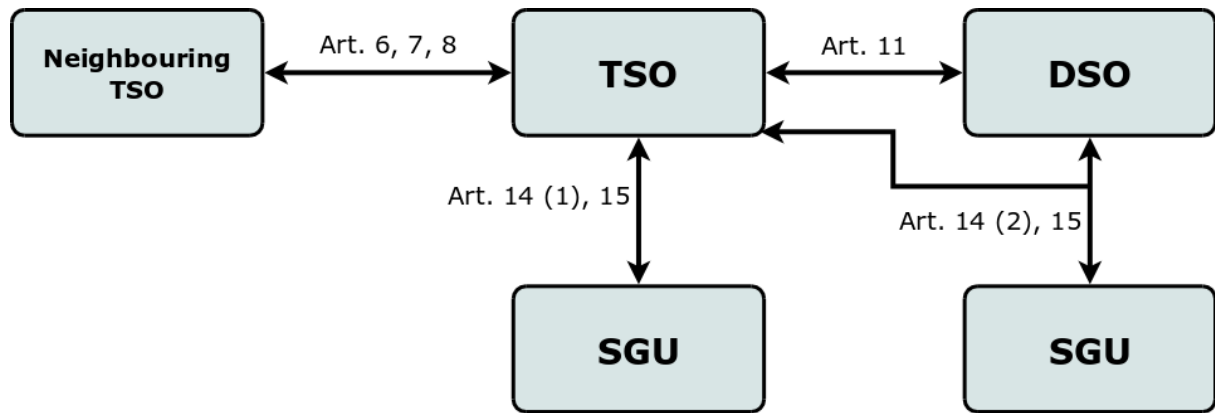


Figure 5: Exchange of Structural information

4.2 SCHEDULED INFORMATION

Scheduled information represents the expected functioning of the different elements of the System in the future. Together with structural data allow to prepare a scenario of the expected saturation of the System in a specific moment in the future to perform Security Analysis for that timeframe.

Scheduled information can be divided in two subsets of information: outage planning and generation-load programs, also referred to run-scheduled. All this information can be considered in many different timeframes depending on the moment of the future for which the Analysis are done. Title 2 of SO GL addresses exchanges of scheduled information between Day-ahead and real-time.

At national level, the exchange of run-schedules between a TSO and the DSOs and SGUs within its control area shall be addressed by means of an information system managed by the TSO. The TSO shall define and publish the format of the information and the technical requirements to connect and access the information system. TSOs shall also store information about schedules.

Regarding outage planning, TSOs and DSOs, as grid operators shall communicate the unavailability of their grid elements.

The reference to the articles of the KORRR is indicated in the scheme.

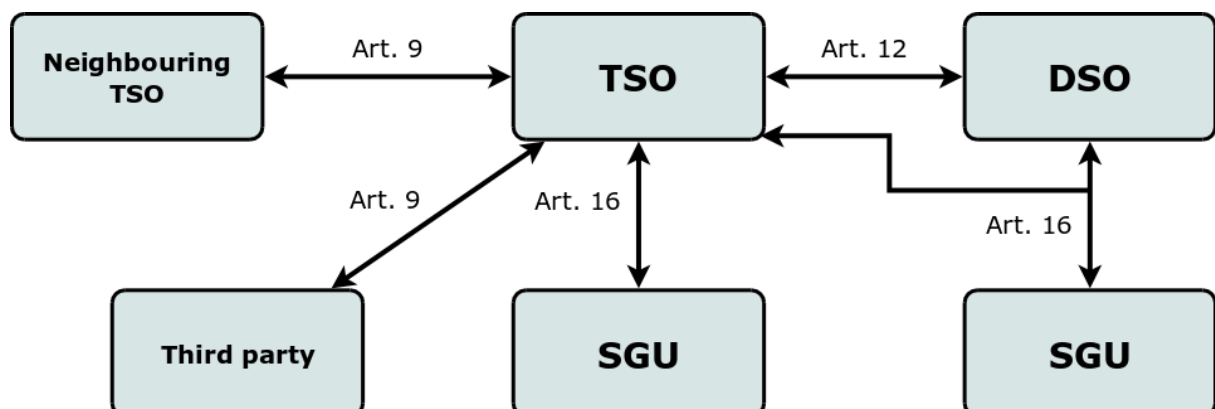


Figure 6: Exchange of Scheduled information

4.3 REAL TIME INFORMATION

Real-time data exchanges for TSO include telemetry measurements or calculated (estimated) values for the following non-exhaustive variables:

- active and reactive powers (line flows, interchange power, generation, load, reserves);
- busbar voltages;
- frequency and frequency restoration control error;
- setpoints (load-frequency controller);
- tap changer positions of transformers and compensating equipment;
- open/close position of switching equipment.

Combined with the structural data, they are used to produce study models used to carry out static and dynamic security analysis in real-time.

All the parties involved have to exchange at least the list of information defined in SO GL.

For real-time data exchange, standard but legacy communication protocols are typically used: inter-control centre protocols (ICCP) as specified in the international standard IEC 60870-6 and the device oriented information modelling and mapping to communication protocols specified in the international standard series IEC 61850, IEC 61970, IEC 61968, IEC 61400-25, IEC 62351, IEC 61325. The update of the information is driven by the protocol used and the local configuration.

The IEC and CEN/CENELEC standardization body have analysed the impressive collection of standards in the field of Smart Grid and communication and cyber security aspects. The IEC Smart Grid Standardization Roadmap provides an overview on these standards. Some of these standards are considered to be core standards for any implementation of communication and cyber security aspects within current and future electricity system.

Core standards are standards that have an enormous effect on any communication and security solution. These core standards are forming the “backbone” of the IEC standards portfolio. The fundamental standards are the following:

- IEC 61850 Power Utility Automation, Hydro Energy Communication, Distributed Energy Resources Communication. The standard series is the fundamental specifications for all communication within future electricity network systems.
- IEC 61970 Common Information Model (CIM). Generation management systems, EMS (Energy Management System)
- IEC 61968 Common Information Model (CIM). Generation management systems, DMS (Distribution Management System); DA; SA; DER; AMI; DR; E-Storage
- IEC 61400-25 communication with wind power plants
- IEC 62351 Security aspects
- IEC 61325 Market communication aspects
- IEC 62056 COSEM – smart grid metering communication
- IEC 61508 Functional safety of electrical/electronic/programmable electronic safety-related systems
- IEC 60870-6 Inter Control Centre Protocols (ICCP) secure communication between control centre.

New standards could provide a more advanced and enhanced functionality that may in the future replace these communication protocols.

All the data gathered by TSOs have to be stored in a data storage updated and maintained by TSOs. DSOs and SGUs can have access to the information referred to own facilities (which is untypical for real-time data exchange).

The following scheme summarizes the flow of information among all the parties involved. The reference to the articles of KORRR is indicated in the scheme.

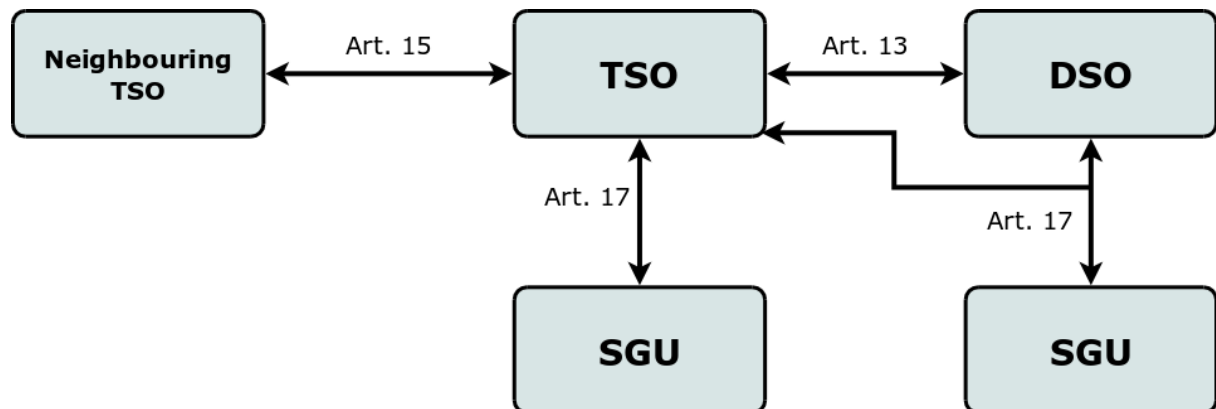


Figure 7: Exchange of Real Time information

5. REFERENCES

- [1] "Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation", Official Journal of the European Union, August 2017"
- [2] "NC OS Supporting Document", ENTSO-E, September 2013
- [3] "OPS Supporting Document", ENTSO-E, September 2013
- [4] "Final LFCR Supporting Document", ENTSO-E, September 2013
- [5] "Supporting Document for the final Network Code on Emergency and Restoration" ENTSO-E, March 2015
- [6] "P.O. 9: Información intercambiada por el operador del sistema" Spanish Regulation, December 2015

[7] "TSO-DSO Data Management report", ENTSO-E, CEDEC, EDSO, Eurelectric, GEODE, July 2016"

[8] SEGCG/M490/G Smart Grid Set of Standards version 4.1, Jan 6th, 2017

6. ASSESSMENT OF THE KORRR AGAINST ARTICLE 40(6)

	Requirements of Article 40(6) of SO GL	Extent to which the provision is met
40(6)	By 6 months after entry into force of this regulation, all TSOs shall jointly agree on key organisational requirements, roles and responsibilities in relation to data exchange. Those organisational requirements, roles and responsibilities shall take into account and complement where necessary the operational conditions of the generation and load data methodology developed in accordance with Article 16 of Regulation (EU) No 2015/1222. They shall apply to all data exchange provisions in this Title and shall include organisational requirements, roles and responsibilities for the following elements:	<p>Article 1 of KORRR states the subject matter and scope and defines this proposal as the common one by all TSOs according to article 40 (6) of SO GL.</p> <p>Whereas (3) recognizes the link with GLDPM developed according with article 16 of Regulation (EU)2015/1222 establishing a guideline on CACM. GLDPM establishes which data has to be provided by whom and when to prepare the common grid model, while the KORRR addresses who must exchange data as well as, how and when to perform the tasks defined in the SO GL. Furthermore, the GLDPM only refers to data exchange up to the day ahead, while KORRR also includes data exchange up to real time.</p>
a	obligations for TSOs to communicate without delay to all neighbouring TSOs any changes in the protection settings, thermal limits and technical capacities at the interconnectors between their control areas;	All types of information referred to in article 40 (6) (a) are included in the structural data of elements included in observability area. Article 7 of KORRR states the requirements for TSOs to exchange the structural data necessary to operate the system. The cases to update the structural data share with other TSOs is defined in Article 8
b	obligations for DSOs directly connected to the transmission system to inform their TSOs, within the agreed timescales, of any changes in the data and information pursuant to this Title;	<p>Article 7 states the obligation for DSOs to provide the TSO with the structural information and article 11 (1) defines the case when the information needs to be updated.</p> <p>Article 12 (1) defines the provision of scheduled data from DSOs to TSOs.</p> <p>Article 13 (1) defines the obligation for the DSO to provide real time data to the TSO.</p>
c	obligations for the adjacent DSOs and/or between the downstream DSO and upstream DSO to inform each other within agreed timescales of any change in the data and information established in accordance with this Title;	<p>Article 3 (5) states the obligation for adjacent DSOs and/or between the downstream DSO and upstream DSO to inform each other on the processes and formats of any change in the data and information between them.</p> <p>Article 12 (1) differentiates between transmission connected DSOs and non-transmission connected DSOs and the obligations of each one regarding the data exchange.</p>

Requirements of Article 40(6) of SO GL		Extent to which the provision is met
d	obligations for SGUs to inform their TSO or DSO, within agreed timescales, about any relevant change in the data and information established in accordance with this Title;	<p>Article 14 states the obligation for SGUs to provide the TSO/ DSO with the structural information.</p> <p>Article 15 defines the cases when the information needs to be updated.</p> <p>Article 16 defines the obligation for the SGUs to provide schedule data to the TSO/DSO.</p> <p>Article 17 defines the obligation for the SGUs to provide real time data to the TSO/DSO and the requirements that need to be fulfilled.</p>
e	detailed content of the data and information established in accordance with this Title, including main principles, type of data, communication means; formats and standards to be applied, timing and responsibilities;	<p>Article 7 establishes that the TSO shall define and publish the detailed content and formats to communicate structural information.</p> <p>Article 9 defines the responsibilities of the TSOs regarding the exchange of scheduled data. Among them there are the settlement of an information system to exchange that information, the format used by the information system and the requirements to connect to it.</p> <p>Article 10 stated the responsibility for the TSO to define standards for real time data exchange.</p>
f	the time stamping and frequency of delivery of the data and information to be provided by DSOs and SGUs, to be used by TSOs in the different timescales. The frequency of information exchanges for real-time data, scheduled data and update of structural data shall be defined;	<p>Article 9 (4) defines timestamping for scheduled data exchanges</p> <p>Article 10(2) defines timestamping for real time data exchanges</p> <p>Article 9 (1) states the frequency of delivery of scheduled data</p> <p>Article 10 (5) states the frequency of delivery of real time data</p> <p>Articles 8, 11 (1) and 15 establish the cases where structural information needs to be updated.</p>
g	the format for the reporting of the data and information established in accordance with this Title;	<p>Article 7 establishes that the TSO shall define and publish the detailed content and formats to communicate structural information.</p> <p>Article 9(2) and 9(3) establish that the TSO shall define the format of the scheduled data for the information system.</p> <p>Article 10 establishes that the TSO shall define and publish the requirements and content for real time data exchange.</p>
40(6)	The organisational requirements, roles and responsibilities shall be published by ENTSO for Electricity.	Article 18(1) states the obligation for ENTSO-E (and TSOs) to publish the proposal on internet.

Energitilsynet - anmeldelser

post@forsyningstilsynet.dk

ENERGINET
Myndighedsenheden

Energinet
Tonne Kjærvej 65
DK-7000 Fredericia

+45 70 10 22 44
info@energinet.dk
CVR-nr. 28 98 06 71

Dato:
12. oktober 2018

Forfatter:
HLJ/HLJ

OPDATERET ANSØGNING OM GODKENDELSE AF KORRR, ORGANISATORISKE KRAV, ROLLER OG ANSVARSOMRÅDER VEDR. DATAUDVEKSLING

Energinet anmelder hermed opdateret ansøgning om godkendelse af KORRR, organisatoriske krav, roller og ansvarsområder vedr. dataudveksling i henhold til Kommissionens forordning (EU) 2017/1485 af 2. august om fastsættelse af retningslinjer for drift af elektricitetstransmissionssystemer, herefter SO GL.

Baggrund

I henhold til SO GL artikel 40, stk. 6 skal alle TSO'er i fællesskab udarbejde forslag til metode for organisatoriske krav, roller og ansvarsområder vedr. dataudveksling (KORRR). Disse organisatoriske krav, roller og ansvarsområder tager hensyn til og supplerer om nødvendigt driftsbetingelserne i metoden vedrørende data om produktion og forbrug, der er udviklet i henhold til Kommissions forordning (EU) 2015/1222 af 24. juli 2015 om fastsættelse af retningslinjer for kapacitetstildeling og håndtering af kapacitetsbegrænsninger artikel 16.

Energinet indsendte forslaget til godkendelse hos Forsyningstilsynet den 14. marts 2018. Forsyningstilsynet har ved mail den 7. august bedt Energinet ændre forslaget.

Høring

KORRR har været i offentlig høring fra den 31. oktober 2017 til den 1. december 2017. Alle høringssvar samt håndtering af svar er samlet i ét "Response to public consultation Comments" dokument, hvilket blev indsendt til Forsyningstilsynet den 14. marts 2018.

Anmodning om godkendelse

Energinet anmoder Forsyningstilsynet om at godkende det vedhæftede opdaterede forslag All TSOs' proposal for the Key Organisational Requirements, Roles and Responsibilities (KORRR) relating to Data Exchange in accordance with Article 40(6) of Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a Guideline on Electricity Transmission System Operation (181009_KORRR_for_submission_to_NRAs.pdf).

Energinet fremsender desuden dokumentet Supporting document to all TSOs proposal for key organisational requirements, roles and responsibilities (KORRR) relating to data exchange til orientering (181009_KORRR_supporting document.pdf).

Spørgsmål til forslagene

Ved spørgsmål til KORRR kontaktes myndighed@energinet.dk, cc. Knud Johansen (KDJ@energinet.dk).

Med venlig hilsen



Helle Birte Jensen

hlj@energinet.dk
Energinet